


REFER TO SPECIFIC PRODUCT CATALOG TO DETERMINE ACTUAL MAXIMUM AND MINIMUM AIRFLOW LIMITS DICTATED BY INLET SIZE AND CONTROL TYPE.

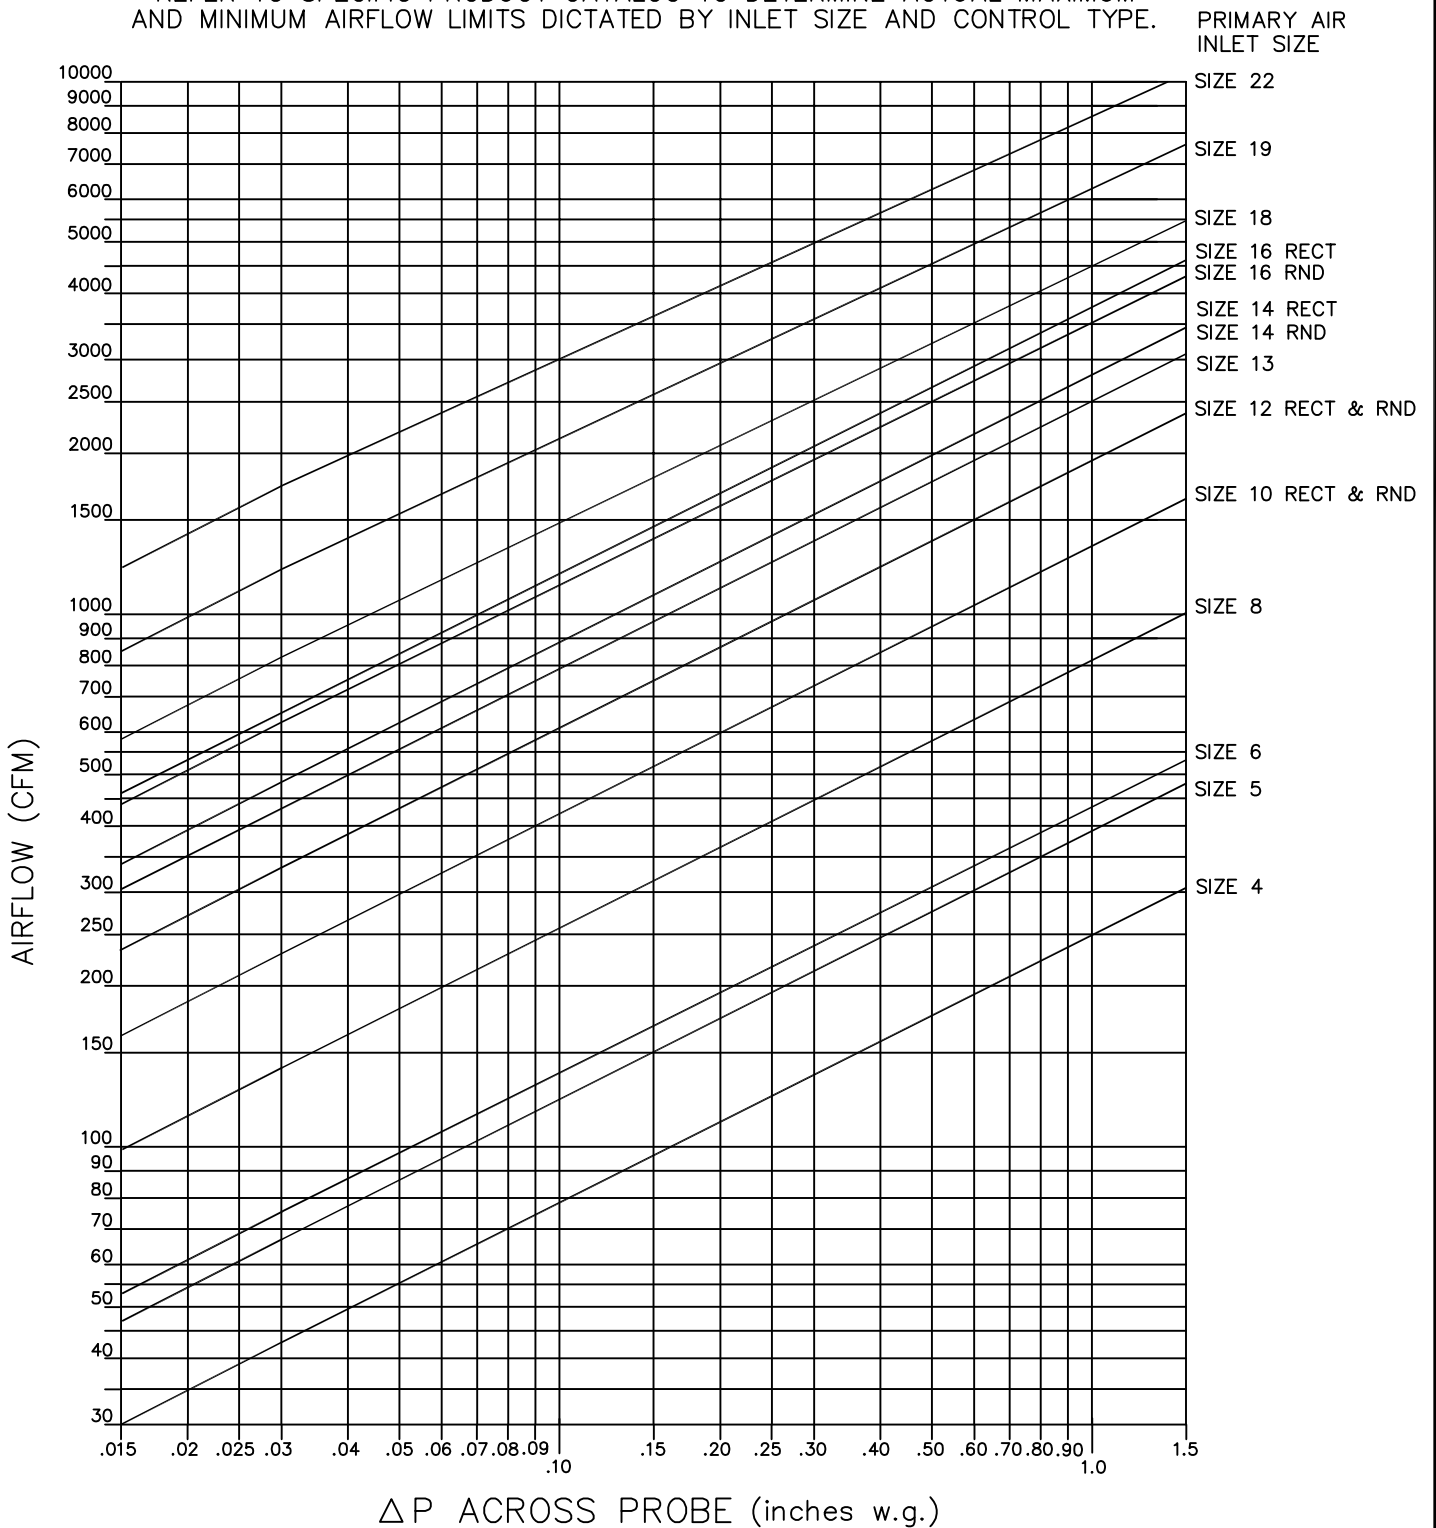

For optimum control accuracy, a straight section of duct at least 1.5 duct diameters long and the same diameter as the inlet collar should be installed upstream of the terminal inlet. Sizes 6 through 22 utilize FlowStar™ multi-axis center averaging sensor; Sizes 4 and 5 utilize single-axis, linear averaging multi-point sensor.

form: A-submittal-V.dwg rev.1

TITLE: ΔP vs CFM @ INLET FOR MODELS SDR, SDL, SGX, DDR, CFR, CFRQ, CFL, VFR & VFL WITH PNEUMATIC OR DDC CONTROLS BY OTHERS WHICH USE A "DEAD END" TYPE PRESSURE TRANSDUCER			
DRN BY: AWW	DATE: 15 JUL 93	SCALE: 1=1	DRAWING NO.
CKD BY: DB	DATE: 9/5/08	REV: 05	16431
THIS DRAWING CONTAINS PROPRIETARY DATA. UNAUTHORIZED DISCLOSURE, REPRODUCTION, OR USE IS STRICTLY PROHIBITED WITHOUT WRITTEN PERMISSION.		DO NOT SCALE DRAWING DIMENSIONS AND DATA ARE SUBJECT TO CHANGE WITHOUT NOTICE. CONTACT FACTORY FOR CERTIFIED DRAWINGS.	